

Ponndorf

**Hose Pump
Series
*P_delta / PD-S***



Operation Manual

1. Content

2. General	3
2.1 Service address	3
2.2 General information	3
2.3 Labelling	4
2.4 Guarantee	5
2.5 Technical data	5
3. Safety	6
3.1 Marking of details in the operation manual	6
3.2 Safety instructions for hose pumps in hazardous locations	7
3.3 Intended use	7
3.4 Qualification and training of personnel	8
3.5 Dangers in case of non-observance of the safety instructions	8
3.6 Safety-conscious working	9
3.7 Safety instructions for the operator/user	9
3.8 Safety instructions for maintenance / inspection / assembly	9
3.9 Unauthorized modifications or use of unoriginal parts	10
3.10 Unauthorized operating methods	10
4. Transport, storage and disposal	11
4.1 Transport	11
4.2 Storage	11
4.3 Disposal	11
5. Description of pump and accessories	12
5.1 Detector for hose leakages	13
5.2 Diagram of the leakage detector for operating the pumps in non-hazardous locations (art.-no. 93-000-055)	14
5.3 Diagram of the leakage detector for operating the pumps in non-hazardous locations (art.-no. 93-000-009)	15
6. Installation / Connection / Operation	16
6.1 Installation of pumps in hazardous locations	16
6.2 Electrical connection	16
6.3 Mechanical connection	18
6.4 Installing the pump hose	20

7.	Maintenacnce / Service	22
7.1	Changing the pump hose.....	22
7.2	Maintenance / Service	23
7.3	Cleaning	23
7.4	Adjustment of gap.....	24
7.5	Drawing of spare parts – flanged version.....	25
7.6	List of spare parts – flanged version	25
7.7	Drawing of spare parts – coupled version	26
7.8	List of spare parts – coupled version	26
7.9	Troubleshooting.....	27
8.	Characteristic curves	28
9.	Accompanying documents	29

2. General

2.1 Service address

PONNDORF GERÄTETECHNIK GmbH
Leipziger Strasse 374
D - 34123 Kassel
Tel. 0561 / 51139 - 0
Fax: 0561 / 51139 - 88
E-Mail: service@ponndorf.de

2.2 General information

Ponndorf Hose Pumps are a self-priming positive displacement pumps without any glands or valves. The pumping medium only comes in contact the inner surface of the pump hose, but not with the moving parts of the pump. Therefore the pumps are particularly suitable for pumping aggressive, abrasive and viscous liquids, but as well for pumping liquids containing coarse-grained solids and sensitive materials which require to be pumped gently.



Priming and pumping of combustible gases or fumes is prohibited. Start-up and shutdown processes which require this should only be rarely and kept as short as possible. Dry running of the pump (operation without the pumping media) must generally be avoided, apart from the start-up and shutdown processes mentioned before.



The operator must ensure that the relevant safety regulations (e.g. TRGS 727) for the pumped medium are observed to avoid dangerous electrostatic charging. Among other things, please consider flow velocities, etc.



Hose pumps are only intended to pump free-flowing liquids but not to pump gaseous pumping media.



The functioning of a hose pump can lead to abrasion on the pump hose. For applications in which the possible abrasion is intermittent or not permissible, appropriate filter technology must be provided by the customer.



To guarantee the tightness and chemical compatibility of the pump hoses, the manufacturer of the hose pump must be consulted in case of possible changes of the pumping media unless this information does not appear from available documents.



To avoid blockages of the pumps and/or any other damages of pumps or pump hoses, the operator must guarantee that no hose damaging objects can invade the hoses (e.g. sharp-edged or too big and not pumpable objects). A suitable strainer may be used as protection.

2.3 Labelling



1. Pump Type 1)
2. Maximum Pressure
3. Pump Number and Year of Manufacture
4. ATEX Coding (optional)
5. Ambient Temperature Limit in EX-Zone (optional)
6. Customer Number – Order Number Ponndorf

- 1) Explanations of pump type: PD-S corresponds to series P_delta
Examples:
- PD3_15-S = P_delta 15, 3-rollers-rotor
- PD4_19-S = P_delta 19, 4-rollers-rotor

The data specified on the name plate refer to the delivery status of the Ponndorf Hose Pump. Any modification of the pump can result in a change of the specified data and the request of a new name plate for the Ponndorf Hose Pump could be necessary.

When requesting spares, the model and serial number should always be quoted.

2.4 Guarantee

The guarantee for defects of any goods delivered by us is stated in our Terms and Conditions of Sale.

We do not assume any liability for defects and damages which are caused by non-observance of the instructions of the operation manual.

Furthermore we assume no liability for defects or damages which are caused by changing the operating conditions (use not in accordance with the intended use), e.g. use of a different pumping medium for which the pump hose is not suitable for, higher temperature which exceed the maximum permissible or line losses caused by media with a too high viscosity.

2.5 Technical data

Series		P_delta / PD-S	
Size		15	19
Max. flow rate:	[l/h H ₂ O]	500	975
Max. speed:	[n/min]	168	250
Max. pressure:	[bar]	4	2
Max. suction height:	[m]	7	7
Max. viscosity of pumping media:	[mPas]	35.000	35.000
Max. motor power:	[kW]	0,37	0,37
Weight: execution XXX execution GMC execution GMF	[kg]	10 kg 25 kg	ca. 10 kg ca. 25 kg
Hose material		Natural rubber	Ponnprene F

3. Safety

These instructions contain basic recommendations that should be followed during installation, operation and maintenance. Therefore the operation manual has to be read by the fitter and qualified personnel/operator before installation and operation and must always be available at the location of the machine/facility.

Not only the general instructions of safety mentioned in chapter - Safety - have to be observed. The more specific safety instructions mentioned in other chapters must be observed, too.

3.1 Marking of details in the operation manual

Non-observance of the safety instructions of this operation manual can endanger people. Those instructions are particularly marked with the following general danger signs:



Safety sign according to DIN 4844 - W 9



Safety sign according to DIN 4844 - W 8
when warning of electrical hazards



Product-specific properties for explosion protection according to 2014/34 / EU are marked with the label in the operating instructions, e.g. the intended use, temperatures.



The symbol is used in the operating instructions to mark safety-related information relating to Directive 1999/92 / EC (ATEX operating directive) that must be observed when operating the pumps, e.g. maintenance information.

CAUTION

In case of safety instructions which can cause dangers for the machine or its performance the term **CAUTION** is interpolated.

Signs directly fixed to the machine, e.g.

- arrows which indicate the flow rotation
- signs for fluid connections

have to be observed and must be kept in a readable condition.

3.2 Safety instructions for hose pumps in hazardous locations



- Explosive gas mixture or dust concentration can cause serious or even fatal injuries in conjunction with hot, voltaged, pressurized and moved parts of the pump
- Only qualified technical personnel is authorized to effect installation, connection, operation as well as maintenance and repair works in consideration of
 - provided instructions
 - danger signs and/or decal information
 - every other provided instructions for the user
 - the system-dependent regulations and requirements
 - the currently valid regulations concerning explosion protection and safety as well as rules for accident prevention
- **The pump in connection with the mobile base plate only fulfils the ATEX directive (EC Directive 2014/34/EC) in a stationary condition.**

In case of moving the pump the operator has to make sure that no explosive environment exists!

3.3 Intended use



- Ponndorf Hose Pumps are intended for use in commercial facilities and are only permitted for use in accordance to the information of the technical documentation and of the nameplate. They comply to the currently valid standards and regulations and meet the requirements of the European directive 2014/34/EC.
- If a pump is coupled to a drive unit, the operating manual of the drive and other provided components must be observed, too.

Before placing the pump into operation the operator must make sure that



- the pump and all other components were not damaged during the carriage.
- the information on the nameplate concerning equipment group and category, zone, temperature class and explosion group accords with the permissible use in the particular hazardous location.
- the air temperature of the ambience of the pump is observed.
- the maximum temperature of the pumping media is not exceeded.
 - +60°C continuous operation
 - +80°C short-time operation (operating time max. 1 h)
- pump hose, clamping rings and connecting sockets are mounted properly and the pump hose is greased sufficiently with Ponndorf special grease (as described in chapter 6.4).

In case of any discrepancies the pump must not be placed into operation!

While placing the pump into operation the characteristics (pump speed, pressure) which are prescribed in the manual and on the nameplate must not be exceeded.

3.4 Qualification and training of personnel

The technical personnel responsible for operation, maintenance, inspection and installation must be qualified for this work. Fields of responsibility, competencies and the supervision of the personnel have to be exactly regulated by the operator. If the personnel is inadequately skilled it must be trained and instructed. If necessary, this may be effected by order of the operator by the manufacturer/supplier.

Furthermore the operator has to make sure that the personnel did absolutely catch the contents of the operation manual.

3.5 Dangers in case of non-observance of the safety instructions

Non-observance of the safety instructions can endanger people, environment and equipment and can result in losing any claim for damages.

In detail non-observance can **for instance** result in the following dangers:

- failure of important functions of the machine/facility
- failure of methods prescribed for maintenance
- threat to people because of electrical, mechanical and chemical effects
- danger to the environment because of leakage of hazardous substances

3.6 Safety-conscious working

The safety instructions of this manual, the existing national rules for accident prevention as well as potential instructions of the operator for work, operation and safety have to be observed.

3.7 Safety instructions for the operator/user

- If hot or cold machine parts cause dangers, the operator is responsible for a protection against contact.
- The protection against contact of moving parts of machines in operation (e.g. coupling) must not be removed.
- Leakages of hazardous pumping media (e.g. explosive, toxic, hot) have to be discharged in a way which guarantees that no dangers to people and environment arise. Legal regulations have to be observed.
- Dangers caused by electrical power have to be eliminated.
(Please see also regulations e.g. of the VDE (in Germany) or of the local power supply companies.)



3.8 Safety instructions for maintenance / inspection / assembly

The operator has to make sure that all maintenance, inspection and installation works will be effected by authorized and qualified technical personnel, which is familiar with the contents of the operating manual.

Basically all works may only effected during shutdown periods. The proceeding to shutdown the machine described in the operating manual must be strictly observed.

Pumps or aggregates which convey harmful media have to be cleaned.

When works are finished all safety installations and protectors must immediately be refitted or be put into operation.

The articles of chapter 6 (Installation / Connection / Operation) have to be observed before reconnection.

3.9 Unauthorized modifications or use of unoriginal parts

Modifications of the machine are only permissible after prior consultation of the manufacturer. Original spare parts and accessories authorized by the manufacturer serve the safety. Use of other parts can repeal the liability for any consequences.

3.10 Unauthorized operating methods


The reliability of the supplied machine is only guaranteed in case of intended use in accordance to chapter 2 - General - of the operating manual.
The limit values stated in the data sheet must not be exceeded in any way.

4. Transport, storage and disposal

4.1 Transport



- When choosing lifting tools and separate lifting accessories the weight of the pump must be taken into consideration. The corresponding accident prevention regulations have to be observed. (In Germany: UVV "Lastaufnahmeeinrichtungen im Hebezeugbetrieb", BG 9a)

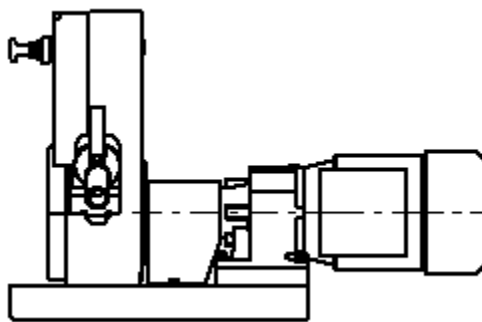

Holes for lifting the pump
(resp. to fix the base plate of stationary pumps)

4.2 Storage

The pump has to be protected against humidity when stored.

CAUTION

In case of longer standstill before placing the pump into operation do not assemble the pump hose, during longer shutdown periods remove the hose from the pump. Otherwise the hose could be warped by the constant compression of the rollers!

4.3 Disposal



With prolonged use, pump parts can get contaminated by poisonous or radioactive pumped liquids to such an extent that cleaning may be insufficient.




CAUTION

Risk of poisoning and environmental damage by the pumped liquid!

- Use suitable personal protective equipment when carrying out any work on the pump.
- Prior to disposal of the pump:
 - Remove and dispose grease in accordance with local regulations.
 - Dispose any leaking pumped liquid in accordance with local regulations.
 - Neutralize residues of pumped liquid in the pump.
- Dispose of the pump unit and associated parts in accordance with statutory regulations.

5. Description of pump and accessories

The pump is available with directly flanged or coupled drive and is mounted on a base plate. Construction "XXX" means that the pump head is supplied with bare shaft extension without base plate.

	Execution	Description
	- XXX	- pump head with bare shaft extension, without drive
	-GMC	- pump with coupled gear motor horizontal - pump with coupled gear motor vertical
	-GMF	- pump with flanged gear motor horizontal - pump with flanged gear motor vertical (not available for use in hazardous locations)

	P_delta / PD-S
Material pump casing:	Aluminum alloy
Material base plate:	Steel (standard)
Diameter of shaft:	15 mm
Fit:	H7/k6


5.1 Detector for hose leakages

The hose leakage detector is for a continuous monitoring in order to avoid unnoticed hose leakages.

Functional description

In case of a hose leakage the pump can be switched off and an alarm (horn/signal lamp) can be activated. This is only possible when using a motor contactor.

Safe function is only guaranteed with electrically conductive fluids.

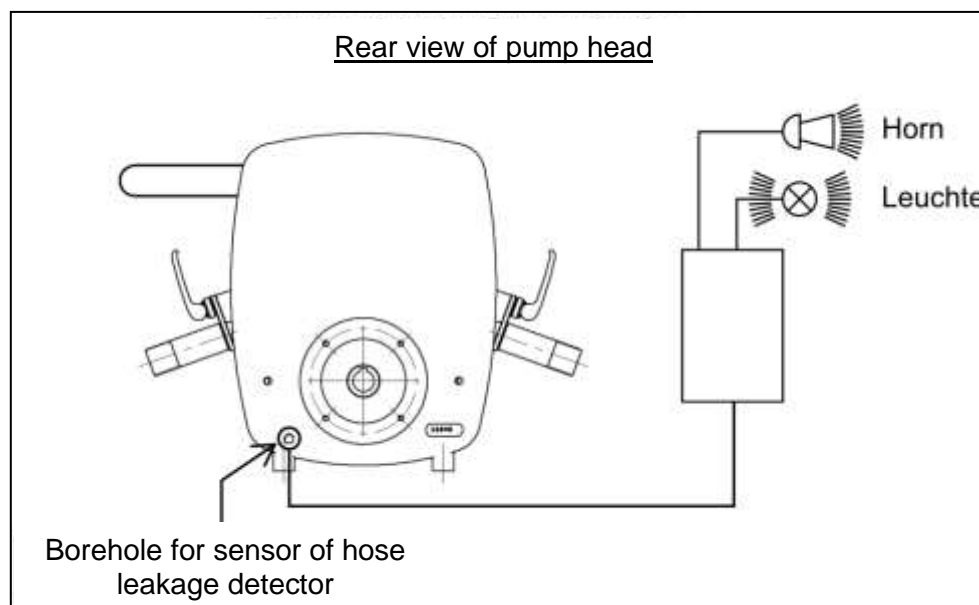

The following mentioned detectors for hose leakages are available:

Part no. 93-000-055

Detector for hose leakages for operating the pumps in non-hazardous locations and for electrically conductive media.

Part no. 93-000-045

Detector for hose leakages with PLC sensor for operating the pumps in non-hazardous locations and for electrically conductive and non-conductive media.

Part no. 93-000-009

Detector for hose leakages for operating the pumps in hazardous locations and for electrically conductive and non-conductive media.


CAUTION

If other sensors are used, the operator is responsible for checking their suitability.

5.2 Diagram of the leakage detector for operating the pumps in non-hazardous locations (art.-no. 93-000-055)

The following diagram is only valid for the leakage detector consisting of:

- sensor for leakage detector (make Ponndorf, standard)
- switch amplifier (make: Disibeint, type DNSA)

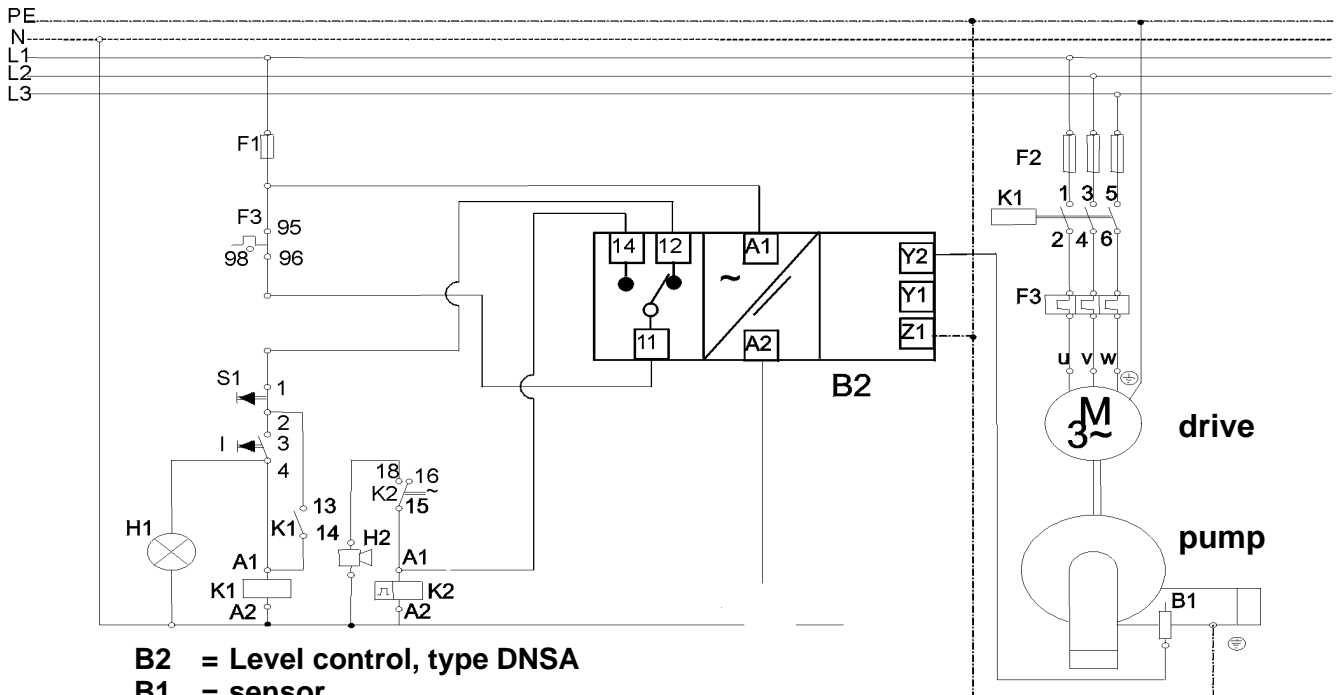

- B2** = Level control, type DNSA
B1 = sensor
F1 = fuse
F2 = motor fuse
F3 = motor overloads
H1 = run light
H2 = signal horn, signal lamp
K1 = motor contactor
K2 = flasher (0,5 sec.)
M = motor (pump drive)
S1 = push button



The connections must only be made by qualified and authorized personnel!



The standard detector for hose leakages is not suitable for use in hazardous locations and non-conductive media.


5.3 Diagram of the leakage detector for operating the pumps in non-hazardous locations (art.-no. 93-000-009)

The following diagram is only valid for the leakage detector consisting of:

- capacitive proximity switch (make: Rechner)
- switch amplifier (make: Rechner)



The switch amplifier must not be used in hazardous locations. It has to be strictly installed outside of these areas.

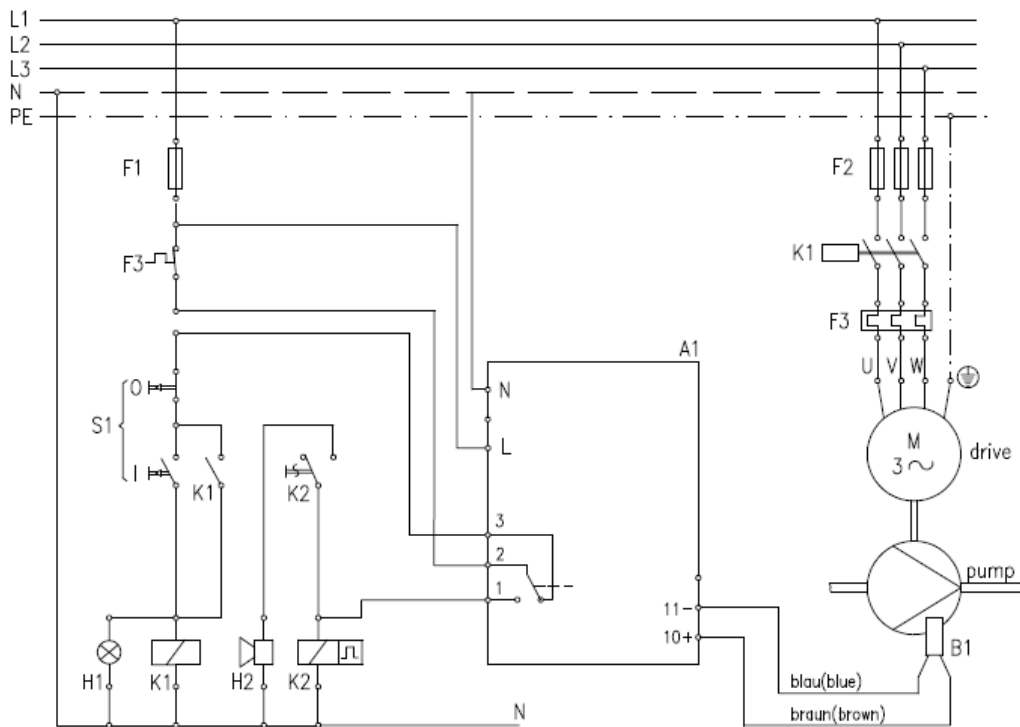

A1 – switch amplifier type N-132/1-01
 B1 – capacitive sensor (2-wire NAMUR)
 F1 – control fuse
 F2 – motor fuse
 F3 – motor protection relays
 H1 – control lamp-operation

H2 – signal horn, signal lamp
 K1 – motor contactor
 K2 – flasher relays 0,5 sec.
 M – motor – pump drive
 S 1 – double push button



The connections must only be made by qualified and authorized personnel!

6. Installation / Connection / Operation

Installation

The installation of the pump depends on the pump type and can be made stationary or movable (on wheels).

6.1 Installation of pumps in hazardous locations



- When pumps have to be installed in hazardous locations the instructions in chapter 3.2 must be strictly observed.
- Ponndorf Hose Pumps of series P_delta for hazardous location use (optional!) meet the construction requirements of equipment group II, category 3G/2G. They are intended for use in zone 1.
- Hose pumps for hazardous location use in construction “0” (see chapter 5 - Description of pump and accessories -)¹⁾
 - are in accordance with temperature class T4.
 - are intended for use at an ambient temperature between +2°C and +40°C (permissible temperature of place of installation).
 - are suitable for pumping media with a maximum temperature of:
 - +60°C in continuous operation
 - +80°C in short-time operation (operating time max. 1 h)
 - fulfill the requirements for non-electrical devices of the type of protection c - protection through safe construction (marking with Ex h for non-electrical explosion protection) - according to EN 80079-36 and EN 80079-37.
 - are allowed for the explosion group IIB.

¹⁾ **The explosion protection for complete aggregates can diverge!** The details of the enclosed declaration of conformity are relevant!

6.2 Electrical connection



The connections must only be made by qualified and authorized personnel!

The connections must be made according to the wiring diagram in the terminal box.

For instructions to effect the electrical connection please see the attached manual of the pump drive!



The pump must be protected by fuses and a protective motor switch according to the nominal current of the motor.



The pumps must be integrated in the equipotential bonding of the whole plant. For example this can be made by grounding the base frame by using the grounding terminal in the terminal box of the motor.


6.3 Mechanical connection

The nominal width of the tubing at the suction and the discharge side should be approx. 25 % bigger than the nominal width of the pump hose.



The size of the hose pump is concurrent to the width of the pump hose.

The tubing on the suction side must be vacuum proof (reinforced) and the tubing on the discharge side must withstand the maximum pressure of the pump. By using a pole changing switch the tubing on suction and discharge side must withstand the maximum pressure of the pump.

Always use flexible tubing to connect the pump with the pipework of your application. The length of the tubing should be at least 1 m. (see fig. 6.3.1).

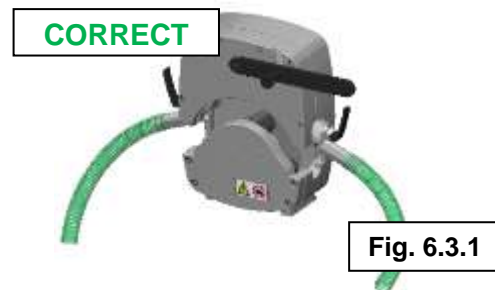

The standard way of connection is flexible tubing (fitting the connecting sockets of the pump), fixed with hose band clamps. Other options (e.g. threaded connections, Kamlok couplings, standard flanges) are available on request.

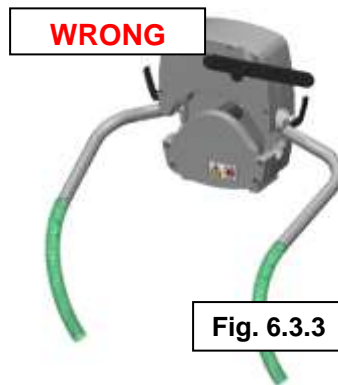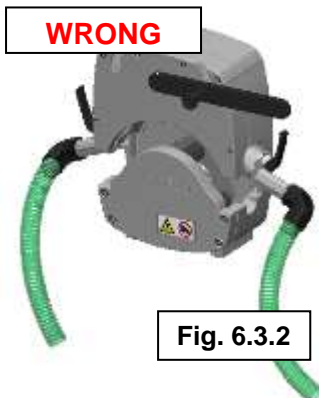

In order to avoid pressure peaks, which can cause damages of the pump hose, there should no pipe bends or 90° elbows be installed directly after the pump on the discharge side (please see fig. 6.3.2 and 6.3.3).

Furthermore the cross section of the pipework on the discharge side should not be reduced (please see fig. 6.3.4).

Important notice for the conveyance of media containing solids

There is a risk of sedimentation of solids which can settle in the pipe system while the pump is stopped. Hereby a lump of solids can be formed which can block the pump when it is restarted. This may cause damages to the pump.

To avoid any damages we recommend in case of longer downtimes to flush the complete piping including the pump sufficiently.



Hose pumps are positive displacement pumps which must not convey against closed fittings (e.g. valves). In case of exceeding the maximum permissible pressure, the pumps or other parts of the facility can be damaged. Therefore a protection against pressure exceedance must be integrated in the pipework on the discharge side (e.g. an overflow valve or a burst disk).



When using overflow valves or burst disks it must be observed that the overpressure always will be discharged in a safe direction. I.e., neither people nor tangible assets may be endangered because of emissions of the pumping medium.



If flammable liquids or gases may leak, the affected area of emission must be free of ignition sources!

6.4 Installing the pump hose

CAUTION

The outer surface of the pump hose must be lubricated sufficiently with Ponndorf Special Grease before assembling it.



Remove power from the pump by removing the main fuses before doing any cleaning / maintenance / assembly operations.



Do not wear gloves during these operations because they may be pulled in!

6.4.1

Pump hose and Special Grease.



6.4.2

Insert fittings into the ends of the pump hose. Make sure that the slots in the fittings point in the same direction.



Then provide pump hose with grease.

6.4.3

Closed pump without hose.



6.4.4

Open the pump by moving the black handle 180°.



6.4.5

Slide the first connector into the guide (screw/slot).



6.4.6

Knurled nut should be tightened if necessary.



6.4.7

First end of the hose is fixed.



6.4.8

Proceed similar with the other end of the hose.



6.4.9

Close the pump by moving the handle back.



6.4.10

Open the lock of the connectors shortly ...



6.4.11

... and close again.
The hose is optimally fixed in the pump.



Pump is now ready for operation!

CAUTION

Before starting the pump it must be secured that any valves assembled in the pipework (on suction and discharge side) are opened. Otherwise the pump or parts of the pipework could be damaged by too high increase of pressure.



The casing cover may only be removed when the drive is switched off and the power supply is interrupted (remove fuses).

CAUTION

If the pump is equipped with a hose leakage monitor it must be ensured that the sensor is not soiled and, in particular, that the pump hose is not lubricated too much, as soiling and deposits on the sensor can impair its functionality.

7. Maintenance / Service

There are no sophisticated procedures of maintenance necessary for Ponndorf Hose Pumps.

Nevertheless there have to be made regular inspections in order to avoid any decrease of capabilities of the pump (e.g. suction capacity / discharge head / flow rate).

7.1 Changing the pump hose



Remove power from the pump by removing the main fuses before doing any cleaning / maintenance / assembly operations !



It must be secured that there are no remains of the pumping medium left in the pump hose (medium could run out or spray). Especially in case of aggressive and caustic media there is danger of injuries !

7.1.1

Closed pump with installed hose.



7.1.2

Open the lock of the connectors.



7.1.3

Open the pump by moving the black handle 180° and take the pump hose with the connectors out of the pump.



For installing the new pump hose please consider chapter 6.4 (picture 6.4.1 – 6.4.11).



Do not wear gloves during these operations because they may be pulled in!

7.2 Maintenance / Service

To guarantee a constant elasticity of the pump hose it must be lubricated with Ponndorf Special Grease every 300 hours of operation. To do this remove the casing cover and put some grease through the opening onto the running surface of the pump hose (e.g. by using a screw driver).

Outer surface of the pump hose	Rotor bearings	Teflon rollers
<ul style="list-style-type: none"> • check on the grease film (enough grease on the running surface of the hose?) • <u>Interval:</u> every 300 hours of operation 	<ul style="list-style-type: none"> • check on proper seat of bearings (no radial play!) • check on unusual heat generation • check on unusual and noticeable bearing noises • <u>Interval:</u> every time when changing the pump hose respectively every 500 hours of operation 	<ul style="list-style-type: none"> • check for proper seat (no seized, not worn out) • <u>Interval:</u> every 500 hours of operation



If the rotor bearings / Teflon rollers show the wear characteristics mentioned above they need to be replaced.

7.3 Cleaning

After pumping media which tend to deposit, the pump hose must be rinsed out when pumping is finished.


When changing the pump hose the inside of the pump casing should be cleaned properly.

7.4 Adjustment of gap

Construction of lifting unit



Eccentric bolt

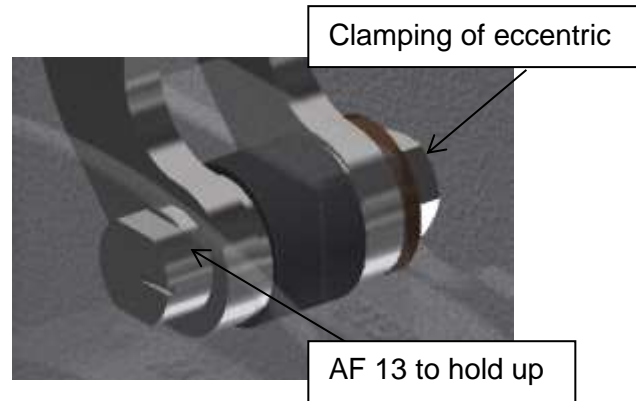

Release the clamp and adjust the eccentric as follows:

P_delta 15
P_delta 19





Normal position
 approx. 11 mm
 approx. 8 mm



Maximum gap
 approx. 12 mm
 approx. 9 mm




Minimum gap
 approx. 10 mm
 approx. 7 mm

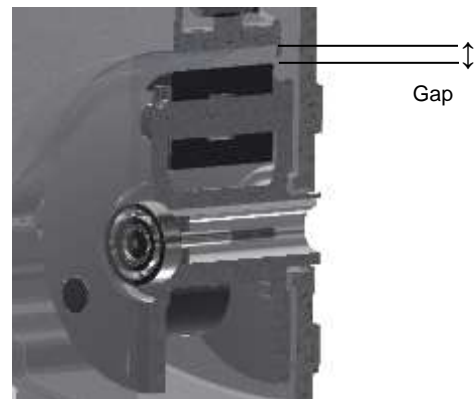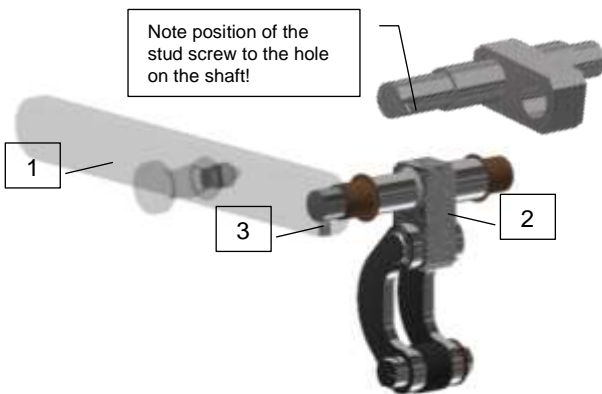

Check correct position of the stud screw pos. 3.
 Angle of pos. 1 to pos. 2 must be 90°.

Check gap between roller and hose bed.
 Finally tighten the eccentric clamp (20 Nm).
 Should min. gap size setting results in a
 dimension > 10/7 mm → check rollers and
 bearings!


7.5 Drawing of spare parts – flanged version

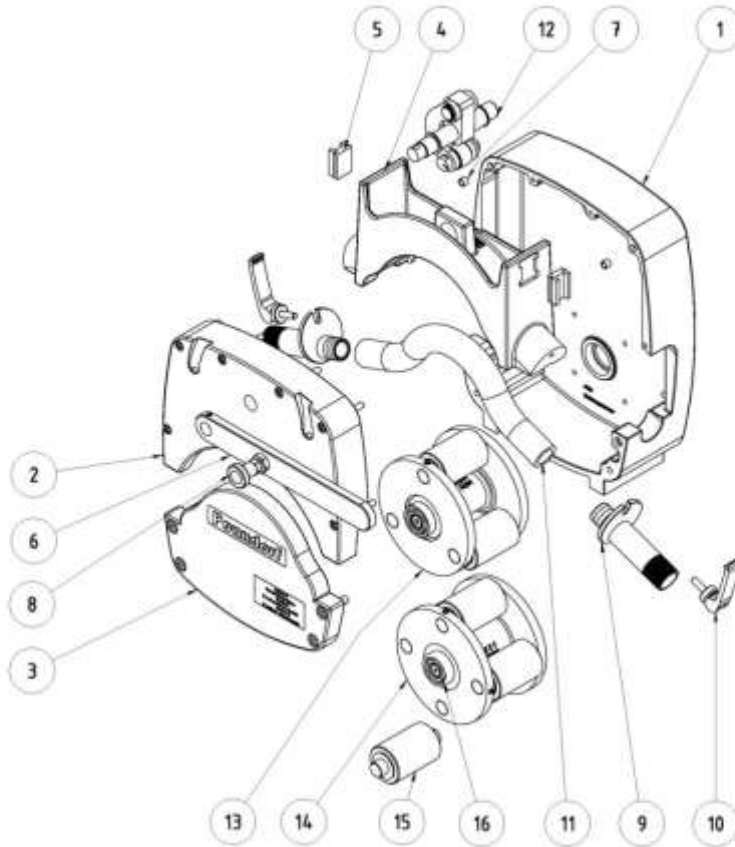

7.6 List of spare parts – flanged version

<u>Part no.</u>	<u>Description</u>	<u>Number /pump</u>	<u>Article no.</u>	
			<u>P_delta 15</u>	<u>P_delta 15</u>
1	Casing	1	40-019-002	40-019-002
2	Cover top	1	40-019-004	40-019-004
3	Cover bottom	1	40-019-006	40-019-006
4	Hose bed	1	40-019-008	40-019-008
5	Gliding element	2	40-019-010	40-019-010
6	Handle	1	40-019-043	40-019-043
7	Centering piece	2	40-019-047	40-019-047
8	Locking bolt, stainless steel	1	40-019-041	40-019-041
9	Connectors, G-Thread 3/4"	2	40-015-029	40-019-029
10	Eccentric clamp with screw	2	40-019-040	40-019-040
11	Hose	1	40-015-070	40-019-072
12	Opening mechanism complete	1	40-019-035	40-019-035
13	Rotor complete (3-rollers rotor)	1	40-015-056	40-019-056
14	Rotor complete (4-rollers rotor)	1	-	40-019-052
15	Teflon rollers complete	1	40-019-017	40-019-017
16	Deep groove ball bearing	1	94-200-007	94-200-007
17	Special grease 250 gr. (not illustrated)	1	21-000-001	21-000-001

7.7 Drawing of spare parts – coupled version

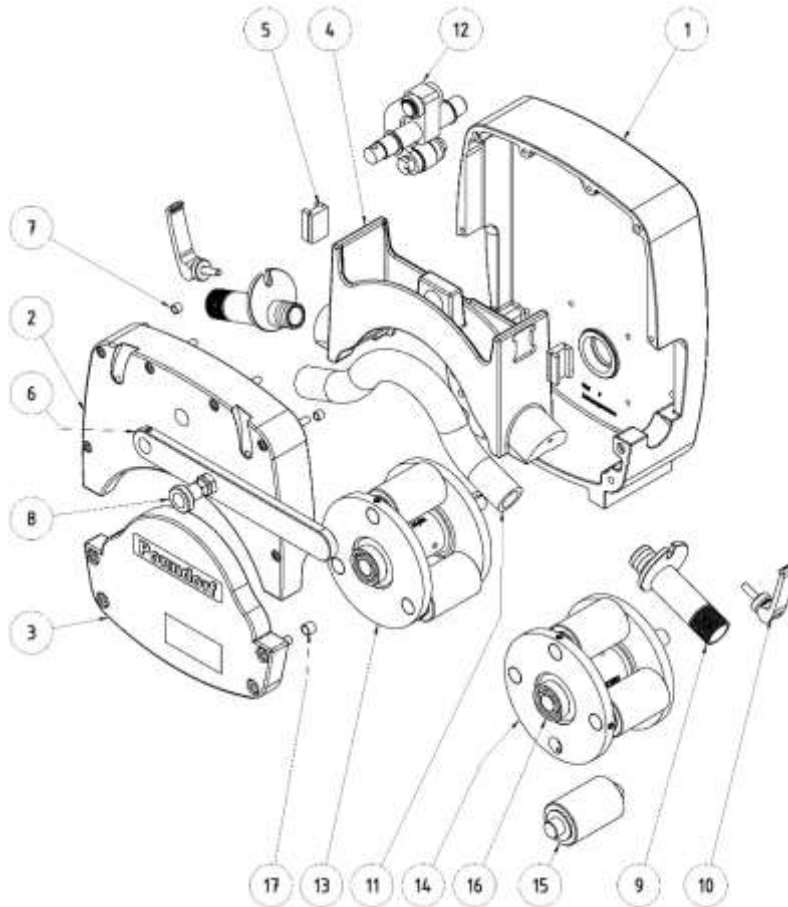

7.8 List of spare parts – coupled version

<u>Teile-Nr.</u>	<u>Benennung</u>	<u>Anzahl/Pumpe</u>	<u>Artikel-Nummer</u>	
			<u>P_delta 15</u>	<u>P_delta 19</u>
1	Casing	1	40-019-002	40-019-002
2	Cover top	1	40-019-004	40-019-004
3	Cover bottom	1	40-019-006	40-019-006
4	Hose bed	1	40-019-008	40-019-008
5	Gliding element	2	40-019-010	40-019-010
6	Handle	1	40-019-043	40-019-043
7	Centering piece	2	40-019-047	40-019-047
8	Locking bolt, stainless steel	1	40-019-041	40-019-041
9	Connectors, G-Thread 3/4"	2	40-015-029	40-019-029
10	Eccentric clamp with screw	2	40-019-040	40-019-040
11	Hose	1	40-015-070	40-019-072
12	Opening mechanism complete	1	40-019-035	40-019-035
13	Rotor complete (3-rollers rotor)	1	40-115-056	40-119-056
14	Rotor complete (4-rollers rotor)	1		40-119-052
15	Teflon rollers complete	1	40-019-017	40-019-017
16	Deep groove ball bearing	1	94-200-007	94-200-007
17	Centering sleeve	2	40-119-047	40-119-047
18	Special grease 250 gr. (not illustrated)	1	21-000-001	21-000-001

7.9 Troubleshooting




Always disconnect the pump in cause of fault!


Malfunction							Possible cause	Remedy
No suction	No pumping	Low flow rate	Low hose life	High pump temperature	Pump does not start	High pipe work vibrating		
X	X	X					Maximum suction height exceeded	Check suction height
X	X	X					Leaking of suction line	Check suction line and connections
X	X						Blocked pressure line	Check pressure line
		X					Blocked pressure line	Check pressure line
X		X					Wear of rollers / inserts	Replace
			X	X			Insufficient / no grease on hose	→ 7. Maintenance/Service
			X	X			Medium temperature too high	Note permissible temperature
			X				Incorrect hose installation	→ 6.4 Installing the pump hose
			X				High pump speed	Determine max. flow rate to the medium
		X	X				High viscosity of medium	Determine max. flow rate to the medium
			X				Undersized suction and pressure line	Calculate pressure loss
			X				Geometry of suction and pressure line	e.g. do not use a 90° angle
			X				Hose material not suitable for medium	Consult the manufacturer
			X				Sharp-edged particles in the medium	Provide suction filter
					X		Sedimentation of medium on pressure side	Check pressure line
					X		Motor protection started	Check
						X	Insufficient fastening	Check
						X	Pulsation too high	Use pulsation damper
						X	No uncoupling of pump to the pipe system	Use compensator

8. Characteristic curves

P_delta 15 / PD3_15-S

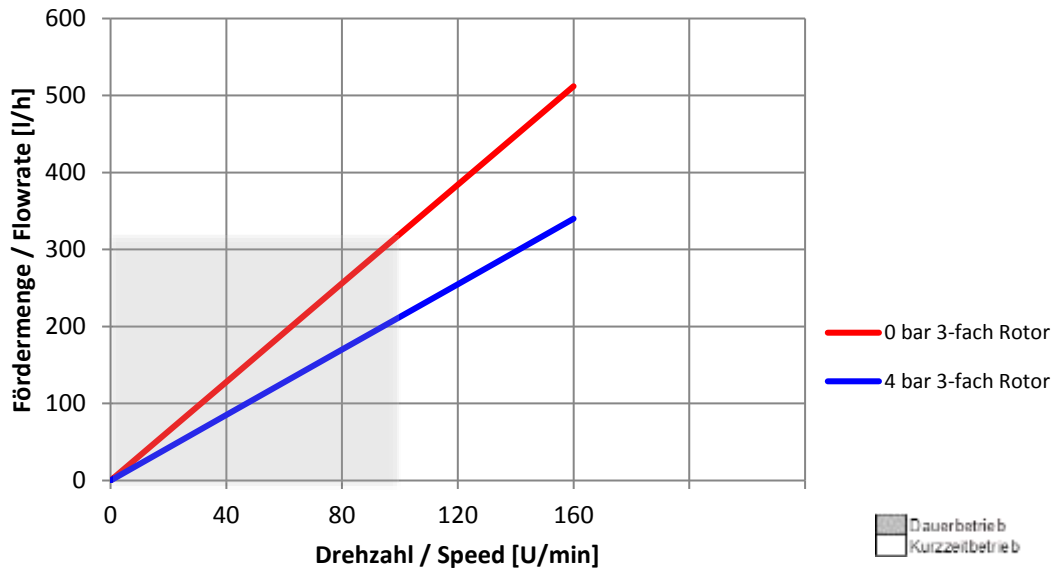

P_delta 19 / PD3_19-S / PD4_19-S

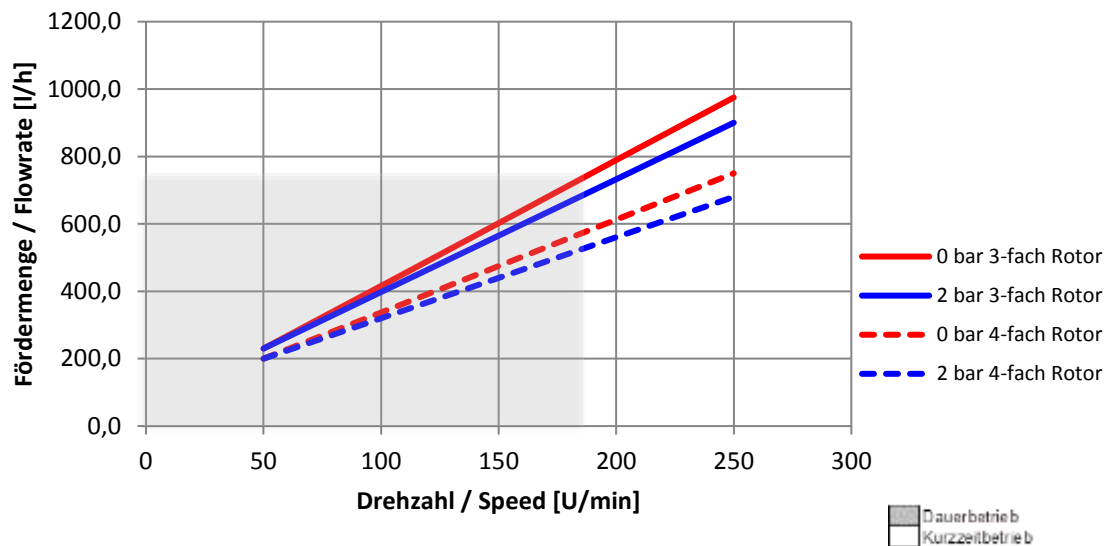

Important:

The characteristic curves are based on pumping water.

So the actual flow rate of the pump can be different in case of pumping media with a higher viscosity!

9. Accompanying documents

Accompanying documents are enclosed (corresponding to the extent of delivery).

EU – DECLARATION of CONFORMITY

Herewith we declare that the products

Designation: **PONNDORF hose pump units of the type**

**P_classic (PC-S); P_classic twin (PC-T)
P_classicplus (PCP-S); P_classicplus twin (PCP-T)
P_food&pharma (PFP-S); P_food&pharma twin (PFP-T)
P_eco
P_eco/food&pharma
P_high pressure (PHP-S); P_high pressure twin (PHP-T)
P_delta (PD-S)
P_change (PCH-S)**

comply in the constructions delivered with the following EC / EU directives

2006/42/EC	Directive of the European Parliament and of the Council on machinery and amending Directive 95/16/EC
2014/35/EU	Directive of the European Parliament and of the Council on the harmonisation of the laws of the Member States relating to the making available on the market of electrical equipment designed for use within certain voltage limits
2014/30/EU	Directive of the European Parliament and of the Council on the harmonisation of the laws of the Member States relating to electromagnetic compatibility

Applied, harmonized standards, in particular: - EN 809 A1/AC

Authorized representative for the completion of the technical documentation :

Till Völker
Ponndorf Gerätetechnik GmbH
Leipziger Straße 374, D – 34123 Kassel

Kassel, March 12, 2021
(Place and date of issue)


.....
Till Völker
General Manager

This declaration is no warrant of properties for the purpose of the product liability. The safety instructions of the operating manual provided must be observed!
If the above mentioned series are technically modified without our approval, this declaration shall no longer be applicable.

EC – DECLARATION of CONFORMITY

Herewith we declare that the products

Designation: **PONNDORF hose humps of the types**

**P_classic (PC-S); P_classic twin (PC-T)
P_classicplus (PCP-S); P_classicplus twin (PCP-T)
P_food&pharma (PFP-S); P_food&pharma twin (PFP-T)
P_eco
P_eco/food&pharma
P_high pressure (PHP-S); P_high pressure twin (PHP-T)
P_delta (PD-S)
P_change (PCH-S)**

complies with the following EC directives

2006/42/EC Directive of European Parliament and of the Council on machinery and amending Directive 95/16/EC

Applied harmonized standards, in particular: - EN 809 A1/AC

Authorized representative for the completion of the technical documentation :

Till Völker
Ponndorf Gerätetechnik GmbH
Leipziger Straße 374, D – 34123 Kassel

Kassel, March 12, 2021
(Place and date of issue)


.....
Till Völker
General Manager

This declaration is no warrant of properties for the purpose of the product liability. The safety instructions of the operating manual provided must be observed!
If the above mentioned series are technically modified without our approval, this declaration shall no longer be applicable.
